

**FOR USE IN AIR HANDLING OPENINGS IN CEILINGS FOR PROTECTION
AGAINST FIRE AND HEAT RADIATION**


QUALIFICATIONS:

- UL 555C Classified Ceiling Damper. (File # 9660).
- CAN4-S112.2 Ceiling Firestop Flap Assemblies.
- California State Fire Marshal: Fire Damper Listing No. 3225-0935:102.

- City of New York Board of Standards and Appeals. Cal. No. 460-88-SA.
- Meets the requirements for NFPA 90A, IBC, BOCA, SBCCI, UBC, NBC (Canada) and associated local building codes.

U.S. Patent No.
4,936,287

Canadian Patent No.
2,014,587-1

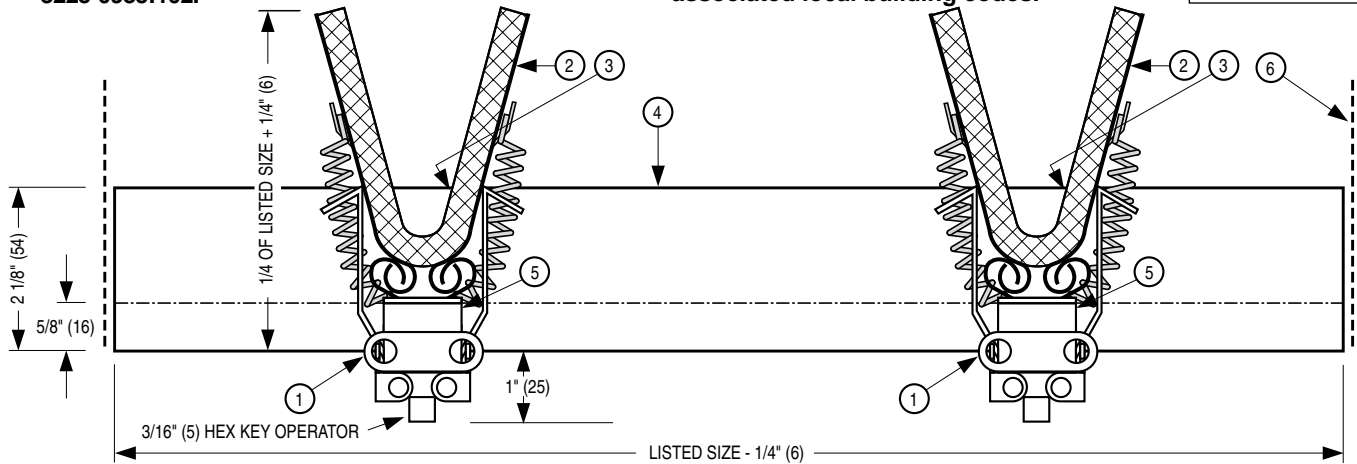

DESCRIPTION:

Ceiling dampers (known as Fire Stop Flaps in Canada) are designed to function as a fire and heat barrier in air handling openings penetrating fire resistive membrane ceilings. The 0700 Series is for use in lieu of hinged door type dampers in any UL/ULC floor/ceiling or roof/ceiling assembly where air handling openings are permitted with up to a 3 hour fire resistance rating.

The Model 0716-4A provides a low profile design by using two sets of blades and is ideal for tight space installation. The blade packs incorporate a mechanism to adjust the opening of the blades for balancing airflow through ceiling diffusers.

CONSTRUCTION:


1. U.L. Listed fusible link, 212°F (100°C), standard.
2. Blades: 22 ga. (0.85) G60 galvanized steel.
3. Insulation: Non-asbestos UL Classified on units over 80 sq. in. (516 sq. cm) finished size, standard. Not required on smaller units.
4. Frame: Roll-formed 22 ga. (0.85) G60 galvanized steel.
5. Adjustable fusible link assembly permits volume control.
6. Duct drop (by others).

NOTES:


1. Maximum size is 24" W x 24" H (610 x 610).
Minimum size is 12" W x 6" H (300 x 150).
2. Units manufactured with blade length on long dimension (W) except where short dimension (H) is less than 12" (300). (See sketch 1).
3. If short dimension (H) is less than 12" (300), units are manufactured with blade length on short dimension. (See sketch 2).
4. For alternate unit with two blades, see dwg. 0700-3, Model 0716A.
5. Installation Instructions: Refer to documents IOM-CRSDINST and CRDTBINST.

OPTIONS:

1. Non-standard temperature U.L. Listed fusible link.
 165°F (74°C)

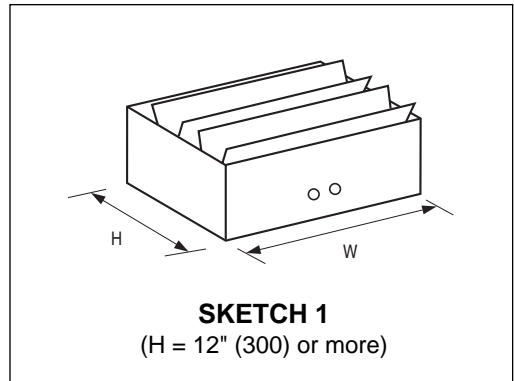

SKETCH 1
(H = 12" (300) or more)

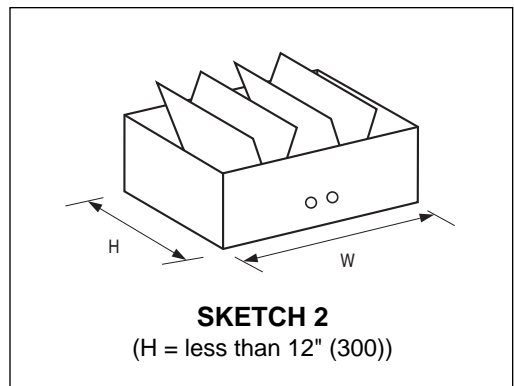

SKETCH 2
(H = less than 12" (300))

Dimensions are in inches (mm).

SCHEDULE TYPE:

PROJECT:

ENGINEER:

CONTRACTOR:

DATE

B SERIES

SUPERSEDES

DRAWING NO.

11 - 1 - 04

0700

31 - 3 - 00R

0700-5